

Central West Pipeline



Legend

- DS** Delivery Stream (APA convention)
- Scheme Pipeline section
- Non-Scheme Pipeline section
- Single direction flow
- Bi-direction flow
- Trade Point


Naming convention:

Connecting Facility
(Delivery / Receipt point)

Nameplate Capacity

Marsden to Dubbo	13 TJ/d
------------------	---------

Delivery – Dubbo (CRP) (DS)

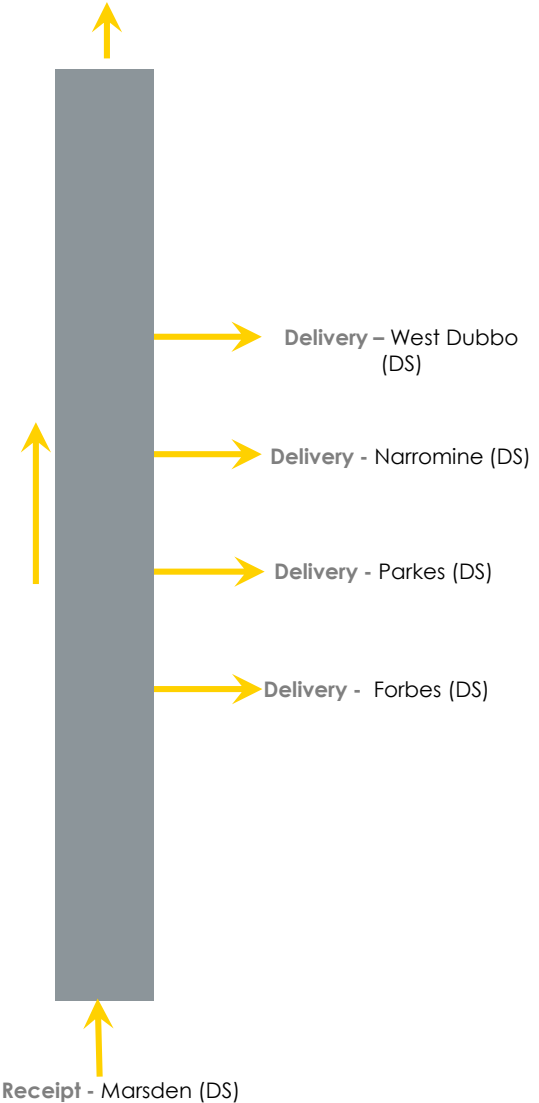

	Point	Value
Receipt Point Pressures		
Min Pressures	Marsden	3,600 kPa
Max Pressures	Marsden	9,400 kPa
Delivery Point Pressures		
Min Pressures	Forbes	1,750 kPa
	Parkes	1,750 kPa
	Narromine	1,750 kPa
	West Dubbo	1,750 kPa
	Dubbo (CRP)	1,750 kPa
Max Pressures	Forbes	9,400 kPa
	Parkes	9,400 kPa
	Narromine	9,400 kPa
	West Dubbo	9,400 kPa
	Dubbo (CRP)	9,400 kPa
Locational MDQs		
Receipt Point MDQs	Marsden	Refer to Marsden Name plate capacity.
Delivery Point MDQs	Forbes	Refer to Gas Station Capacity (Jemena)
	Parkes	Refer to Gas Station Capacity (Jemena)
	Narromine	Refer to Gas Station Capacity (Jemena)
	West Dubbo	Refer to Gas Station Capacity (Jemena)
	Dubbo (CRP)	Refer to Gas Station Capacity (Jemena)

Note: Grey shading represents Scheme pipeline sections.