

# Eastern Goldfields Pipeline System




## Legend

DS	Delivery Stream (APA convention)
	Non-Scheme Pipeline section
	Scheme Pipeline Section
	Single direction flow
	Trade Point
	Leonora Lateral
	Gwalia Lateral
	Yamarna Pipeline
	Mt Morgans Pipeline

## naming convention:

Connecting Facility  
(Delivery / Receipt point)

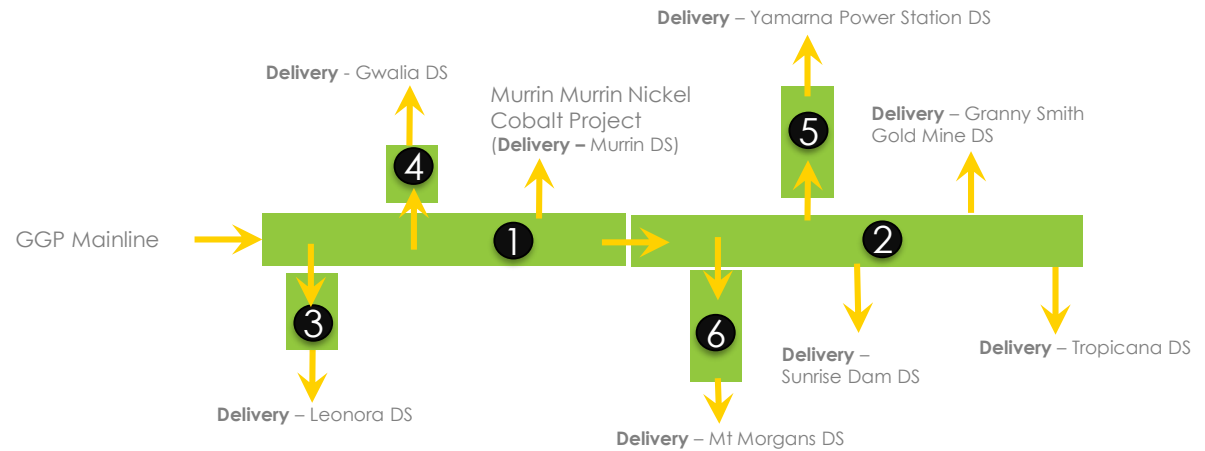

Nameplate Capacities		
1	Murrin Murrin Lateral	45.6 TJ/d
2	Eastern Goldfields Pipeline	20.6 TJ/d

Delivery Point Pressures	Point	Value
<b>Min Pressures</b>	Gwalia	300 kPa
	Leonora	3,000 kPa
	Murrin	3,200 kPa
	Granny Smith Goldmine	1,100 kPa
	Sunrise Dam	1,100 kPa
	Tropicana	1,100 kPa
	Mt Morgans	1,100 kPa
	Yamarna Power Station	1,100 kPa
<b>Max Pressures</b>	Gwalia	10,200 kPa
	Leonora	10,200 kPa
	Murrin	10,200 kPa
	Granny Smith Goldmine	10,200 kPa
	Sunrise Dam	10,200 kPa
	Tropicana	10,200 kPa
	Mt Morgans	10,200 kPa
	Yamarna Power Station	10,200 kPa
<b>Locational MDQs</b>		
<b>Delivery Point MDQs</b>	Gwalia	2.3 TJ
	Leonora	0.5 TJ
	Murrin	22 TJ
	Granny Smith Goldmine	4.2 TJ
	Sunrise Dam	4.5 TJ
	Tropicana	6.5 TJ
	Mt Morgans	2.2 TJ
	Yamarna Power Station	7.75 TJ