

always  
powering  
ahead

apa

# 2022-2023 ICRC Annual Report Summary

Dalton to Canberra Pipeline

October, 2023



2022-2023 ICRC Utility Annual Report Summary

Dalton to Canberra Pipeline

## 1. Purpose

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the Utilities Act 2000 (ACT) (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2. Report summary

### 2.1. Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Environment and Heritage policies and procedures. During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2. Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period. An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during June 2023. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these events occur.

During the 2022-2023 reporting period:

- 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.
- An emergency simulation exercise was conducted during October 2022 using the APA Emergency Response procedures applicable to the pipeline.
- A Safety Management Study for the pipeline was maintained.
- The pipeline is fully protected according to AS2832 - Cathodic protection of metals.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.

### 2.3. Section 3: Officer Details and Authorisation


The release of the annual report was authorised by the APA authorising officer. For any queries in relation to the report or this summary please contact APA Group on email:

APAOperationsRCA@apa.com.au



# 2021-22 ICRC Utility Licence Annual Report Summary

## Dalton to Canberra Pipeline

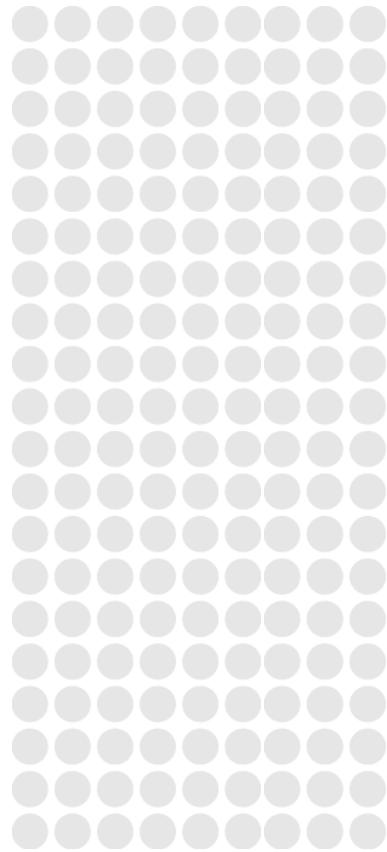

always powering ahead

# 1 PURPOSE

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the *Utilities Act 2000 (ACT)* (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2 REPORT SUMMARY

### 2.1 Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Environment and Heritage policies and procedures.

During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2 Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period.

An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during May 2022. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these event occur.

During the 2021-2022 reporting period:

- A 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.



- An emergency simulation exercise was conducted during October 2021 using the APA Emergency Response procedures applicable to the pipeline.
- A Safety Management Study for the pipeline was completed.
- The pipeline is fully protected according to AS2832 - *Cathodic protection of metals*.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.

### 2.3 Section 3: Officer Details and Authorisation


The release of the annual report was authorised by the APA authorising officer.

For any queries in relation to the report or this summary please contact APA Group on email: [APAOperationsRCA@apa.com.au](mailto:APAOperationsRCA@apa.com.au)



# 2020-21 ICRC Utility Licence Annual Report Summary

## Dalton to Canberra Pipeline

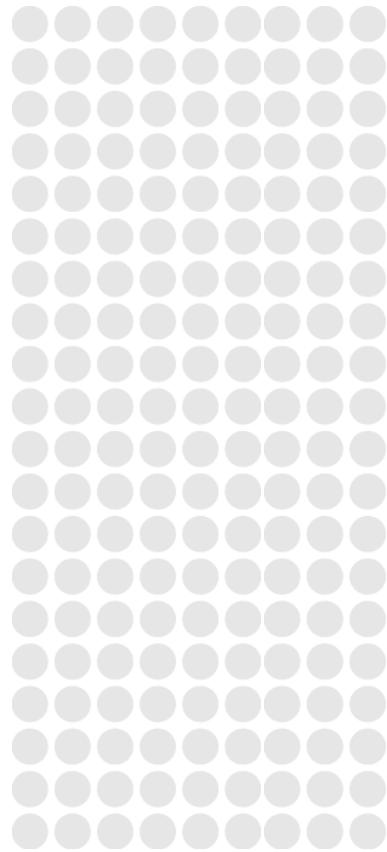

always powering ahead

# 1 PURPOSE

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the *Utilities Act 2000 (ACT)* (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2 REPORT SUMMARY

### 2.1 Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Environment and Heritage policies and procedures.

During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2 Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period.

An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during July 2021. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these event occur.

During the 2020-2021 reporting period:

- A 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.

- An emergency simulation exercise was conducted during October 2020 using the APA Emergency Response procedures applicable to the pipeline.
- A Safety Management Study for the pipeline was completed.
- The pipeline is fully protected according to *AS2832 - Cathodic protection of metals*.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.

### **2.3 Section 3: Officer Details and Authorisation**

The release of the annual report was authorised by the APA authorising officer.


For any queries in relation to the report or this summary please contact Glenn Platt, Risk Compliance and Assurance Specialist, Operations, APA Group on (07) 3223 3301.





# 2019-20 ICRC Utility Licence Annual Report Summary

## Dalton to Canberra Pipeline

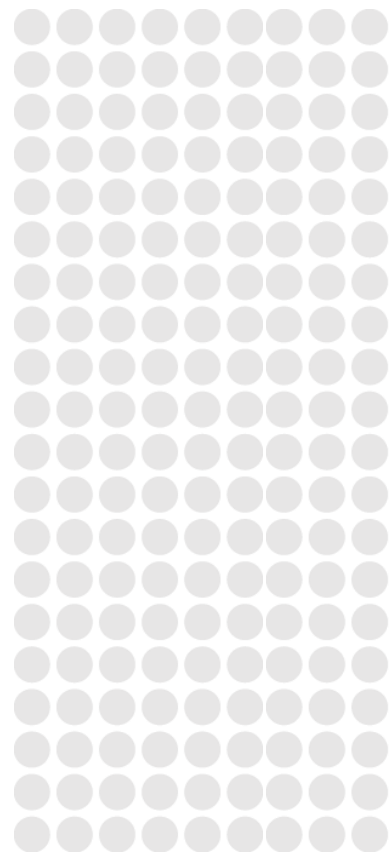



## 1 PURPOSE

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the *Utilities Act 2000* (ACT) (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2 REPORT SUMMARY

### 2.1 Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Environment and Heritage policies and procedures.

During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2 Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period.

An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during August 2020. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these event occur.

During the 2019-2020 reporting period:

- A 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.



- An emergency simulation exercise was conducted during October 2020 using the APA Emergency Response procedures applicable to the pipeline.
- The pipeline is fully protected according to AS2832 - *Cathodic protection of metals*.
- An Inline Inspection Pig Run was conducted.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.
- APA received 8 enquiries to its One Call System. There were 3 third party activities within 10m of the pipeline.

### **2.3 Section 3: Officer Details and Authorisation**


The release of the annual report was authorised by the APA authorising officer.

For any queries in relation to the report or this summary please contact Glenn Platt, Senior Technical Regulatory Specialist, APA Group on (07) 3223 3301.



# 2018-19 ICRC Utility Licence Annual Report Summary

## Dalton to Canberra Pipeline

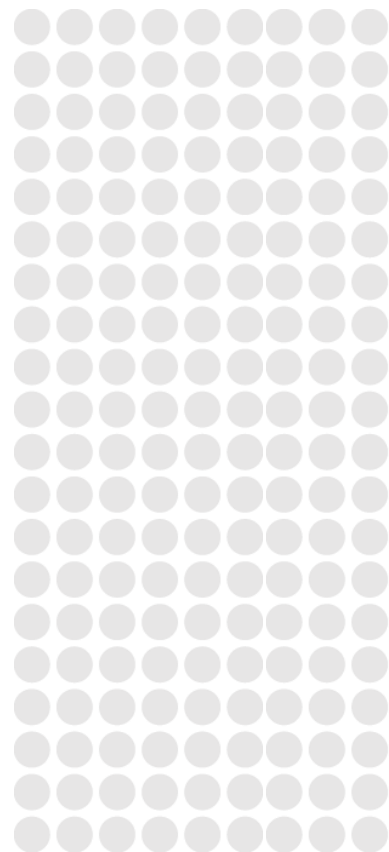



## 1 PURPOSE

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the *Utilities Act 2000* (ACT) (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2 REPORT SUMMARY

### 2.1 Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Heritage, Environment and Land Management policies and procedures.

During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2 Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period.

An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during May 2019. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these event occur.

During the 2018-2019 reporting period:

- A 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.



- An emergency simulation exercise was conducted during May 2019 using the APA Emergency Response procedures applicable to the pipeline.
- An Isolation Plan review for the pipeline was completed.
- The pipeline is fully protected according to AS2832 - *Cathodic protection of metals*.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.
- APA received 21 enquiries to its One Call System. There was one third party activity within 10m of the pipeline.

### **2.3 Section 3: Officer Details and Authorisation**


The release of the annual report was authorised by the APA authorising officer.

For any queries in relation to the report or this summary please contact Glenn Platt, Senior Regulatory Specialist, APA Group on (07) 3223 3301.



# 2017-18 ICRC Utility Licence Annual Report Summary

## Dalton to Canberra Pipeline

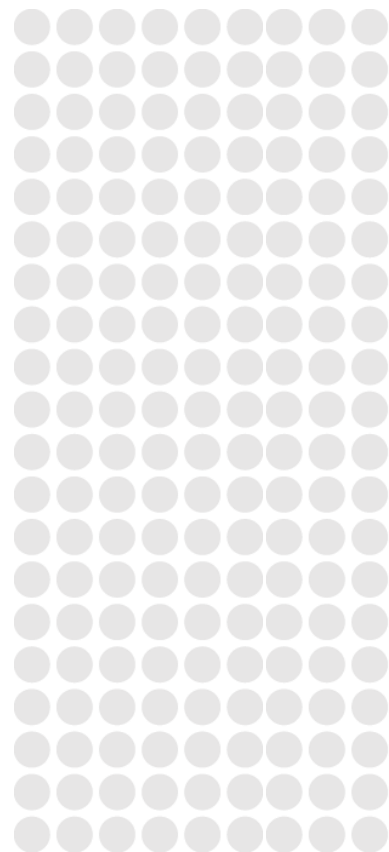



## 1 PURPOSE

This report summary has been prepared in accordance with the requirements of the Licence to provide gas transmission services under the *Utilities Act 2000* (ACT) (the Act) granted to East Australian Pipeline Limited for the portion of the Dalton to Canberra Pipeline located in the Australian Capital Territory (ACT).

## 2 REPORT SUMMARY

### 2.1 Section 1: Exercise of function under the Utilities Act 2000

Activities being undertaken by APA Group (APA) on land are managed under the APA Heritage, Environment and Land Management policies and procedures.

During the reporting period:

- APA did not enter onto landholder's property to undertake operation and maintenance activities.
- APA received no complaint resulting from its operation of the pipeline in relation to land related activities.
- APA did not conduct any activities under notice pursuant to section 109 or 110 of the Act.

### 2.2 Section 2: Utility Licence Conditions

APA Group is not aware of any material breach of licence conditions or legislation during the reporting period.

An annual compliance audit of the APA Pipeline Management System was undertaken by an external auditor during June 2018. The audit found that all measures under the Pipeline Management System are in place that are intended to prevent a hazardous event from occurring and to protect operating personnel, plant, equipment, the community and the environment should these event occur.

During the 2017-2018 reporting period:

- A 24 emergency telephone service was maintained.
- There were no reportable incidents or events.
- There were no restrictions or interruptions to the supply of gas.





- An emergency simulation exercise was conducted during May 2018 using the APA Emergency Response procedures applicable to the pipeline.
- The pipeline is fully protected according to AS2832 - *Cathodic protection of metals*.
- The preventative maintenance schedule was implemented as planned.
- All landowners were contacted.
- APA received 12 enquiries to its One Call System. There were no third party activities within 10m of the pipeline.

### **2.3 Section 3: Officer Details and Authorisation**

The release of the annual report was authorised by the APA authorising officer.

For any queries in relation to the report or this summary please contact Glenn Platt, Senior Regulatory Specialist, APA Group on (07) 3223 3301.