

Eastern Goldfields Pipeline System




Legend

DS	Delivery Stream (APA convention)
	Non-Scheme Pipeline section
	Scheme Pipeline Section
	Single direction flow
	Trade Point
	Leonora Lateral
	Gwalia Lateral
	Yamarna Pipeline
	Mt Morgans Pipeline

naming convention:
Connecting Facility
(Delivery / Receipt point)

Nameplate Capacities		
1	Murrin Murrin Lateral	45.6 TJ/d
2	Eastern Goldfields Pipeline	20.6 TJ/d

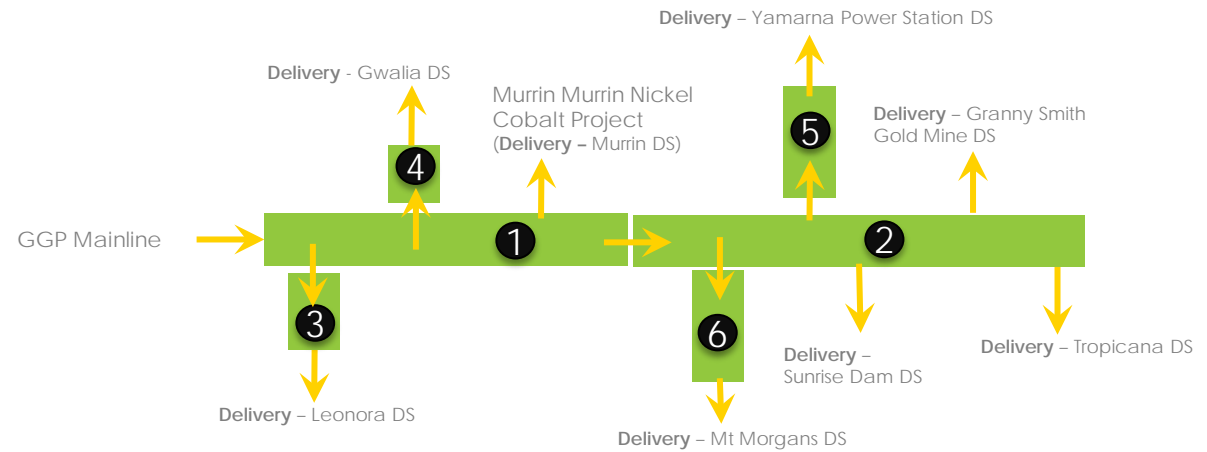

Delivery Point Pressures		
	Point	Value
Min Pressures	Gwalia	300 kPa
	Leonora	3,000 kPa
	Murrin	3,200 kPa
	Granny Smith Goldmine	1,100 kPa
	Sunrise Dam	1,100 kPa
	Tropicana	1,100 kPa
	Mt Morgans	1,100 kPa
	Yamarna Power Station	1,100 kPa
Max Pressures	Gwalia	10,200 kPa
	Leonora	10,200 kPa
	Murrin	10,200 kPa
	Granny Smith Goldmine	10,200 kPa
	Sunrise Dam	10,200 kPa
	Tropicana	10,200 kPa
	Mt Morgans	10,200 kPa
	Yamarna Power Station	10,200 kPa
Locational MDQs		
Delivery Point MDQs	Gwalia	5.0 TJ
	Leonora	5.0 TJ
	Murrin	22 TJ
	Granny Smith Goldmine	5.6 TJ
	Sunrise Dam	5.6 TJ
	Tropicana	5.6 TJ
	Mt Morgans	2.2 TJ
	Yamarna Power Station	7.75 TJ